


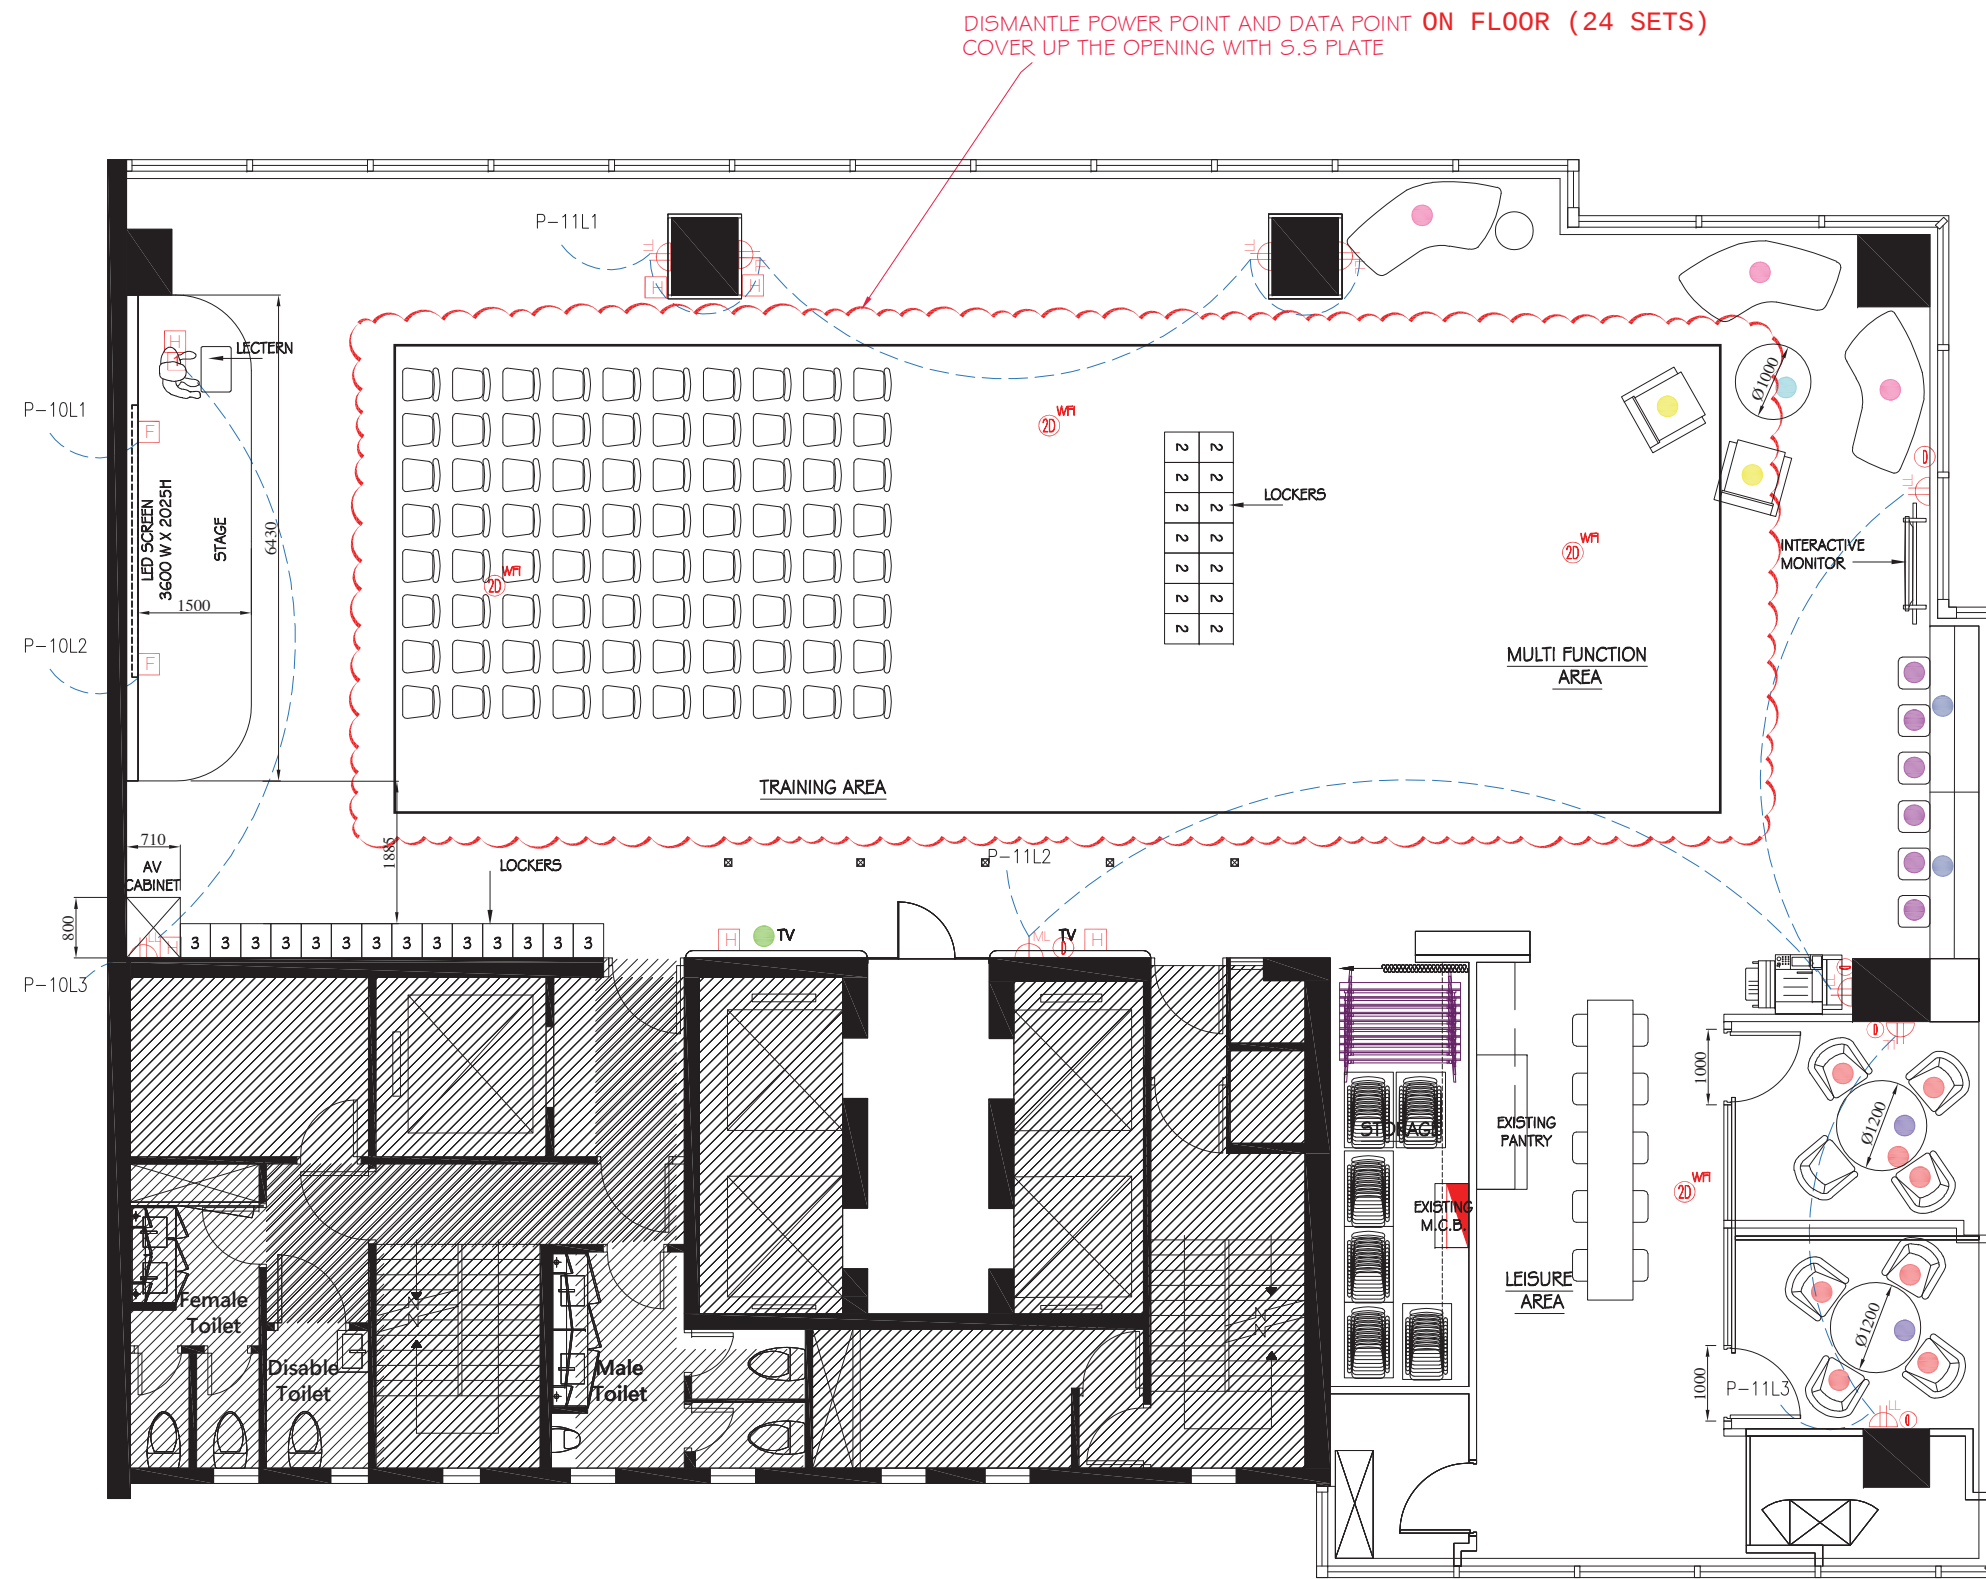

LEGEND			
SYMBOL		DESCRIPTION	
		MCB BOARD	
		13A SOCKET OUTLET	
		13A TWINS SOCKET OUTLET	
		13A TWINS SOCKET OUTLET WITH USB CHARGE PORT	
		DATA / VOICE OUTLET POINT	
		20A CONNECTION UNIT	
		32A COOKER SWITCH	
		63A SPN ISOLATOR SWITCH	
		13A FUSE SPUR UNIT	
		HDMI OUTPUT	
		16A SPN COMMANDO SOCKET	
		POWER MODULE WITH 2 NOS UK POWER, 1 NO. PD6SW, 1 NO. USB	
		FLOOR BOX 1 NO. OF TWINS SOCKET OUTLET 1 NO. OF CONDUIT POINT FOR DATA/VOICE OUTLET	
**X* REFER TO THE BELOW ABBREVIATIONS FOR INSTALLATION LEVEL			
LL	SKIRTING LEVEL	WIFI	WIFI PORT
ML	MIDDLE LEVEL		
HL	HIGH LEVEL		
CM	CEILING MOUNTED		
FM	FLOOR MOUNTED		
FB	FLOOR BOX		
BL	BENCH LEVEL		
TM	TABLE MOUNTED		

- REMARKS**
- ONE CIRCUIT MAXIMUM CAN ONLY BE CONNECTED TO 4 NO. WORKSTATION
 - THE CIRCUIT FOR WORKSTATION CANNOT BE CONNECTED TO CLEANING SOCKET.
 - POWER SOCKET FOR EACH SERVER RACK SHOULD BE CONNECTED TO INDEPENDENT CIRCUIT.
 - NUMBERS OF 13A FUSE SPUR UNIT FOR FAN COIL UNIT, PLEASE REFER TO THE NUMBERS OF FAN COIL UNIT SHOWN ON THE MVAC SERVICE PLAN
 - THE CONTRACTOR IS REQUIRED TO VERIFY THE ACTUAL LOCATION & ROUTE OF ALL MEP RELATED SERVICES ON SITE. ANY DISCREPANCY FOUND BETWEEN THE DRAWINGS AND ACTUAL SITE CONDITIONS MUST BE SUBMITTED FOR APPROVAL PRIOR TO COMMENCEMENT OF WORK. ANY CLAIMS ON WORK DONE WITHOUT PRIOR APPROVAL WILL NOT BE ACCEPTED AND AT THE CONTRACTOR'S OWN RISK.
 - THE CONTRACT IS REQUIRED TO SUPPLY AND INSTALL ALL CABLE CONTAINMENTS FOR ELV SYSTEM, INCLUDING IT, AV, ACCESS CONTROL AND CCTV.